




Installing a Transmission/Gear Pressure SWICHGAGE® using a Pulsation Dampener

Please read the following information before installing. A visual inspection of this product for damage during shipping is recommended before mounting.

WARNING

BEFORE BEGINNING INSTALLATION OF THIS MURPHY PRODUCT

- ✓ Disconnect all electrical power to the machine.
- ✓ Make sure the machine cannot operate during installation.
- ✓ Follow all safety warnings of the machine manufacturer.
- ✓ Read and follow all installation instructions.

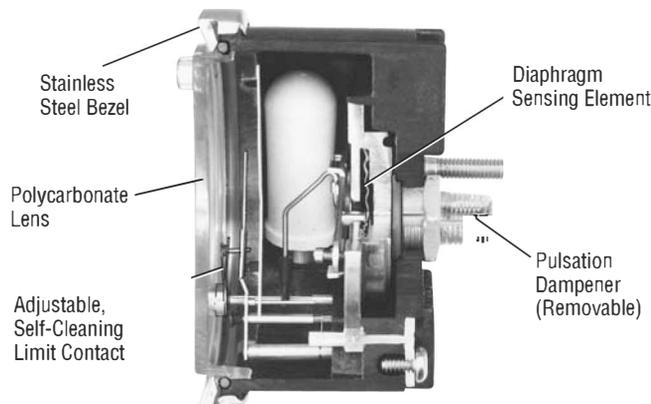

CAUTION: Certain dangers to human safety and to equipment may occur if some equipment is stopped without pre-warning. It is recommended that monitored functions be limited to alarm-only or to alarm before shutdown.

Base Model Description

20P, 25P, A20P and A25P SWICHGAGE®

The gagepointer makes with an adjustable contact to complete a pilot duty circuit.

20PE, 25PE, A20PE and A25PE SWICHGAGE®

Features internal snap-acting SPDT switches, instead of the single pole/pointer contacts. When the switch closes on falling pressure, it becomes Set, as pressure rises the switch Resets.

20PABS, 25PABS, A20PABS and A25PABS SWICHGAGE®

Same as 20P, 25P, A20P and A25P with internal SPDT snap-switch for pre-alarm.

Specifications

Case Material: 20P and 25P Series: *Plated steel.*

A20P and A25P Series: *Polycarbonate.*

Pressure Connection: 1/8-27 NPT.

Contact Rating: Standard is 2A @ 30 VAC/DC resistive (pilot-duty only).

Models 20PE, A20PE, 25PE and A25PE have non-adjustable snap-switch rated 3A @ 30 VDC inductive, 4A @ 125 VAC inductive.

Warranty

A limited warranty on materials and workmanship is given with this Murphy product. A copy of the warranty may be viewed or printed by going to novationcontrols.com/warranty


IMPORTANT Installation Recommendations

SWICHGAGE® Used On Transmission/Clutch Oil Pressure

1. Install the SWICHGAGE® using a Murphy pulsation snubber PD2160 in the pressure connection at the transmission or gear and at the SWICHGAGE®. The snubber helps reduce pressure spikes/surges which will damage the gage sensing element. It also stabilizes the gage readout

through all operating cycles. Failure to isolate gage in this manner will void Murphy warranty and possibly cause equipment damage.

2. Models with pre-alarm have two switch points and when used with Murphy SS300 speed switch—allows changing between high and low switch points according to engine RPM. This configuration does away with nuisance alarms when shifting or when at idle—yet maintains maximum pressure protection. See Murphy Application Tip AT-01 for further details.

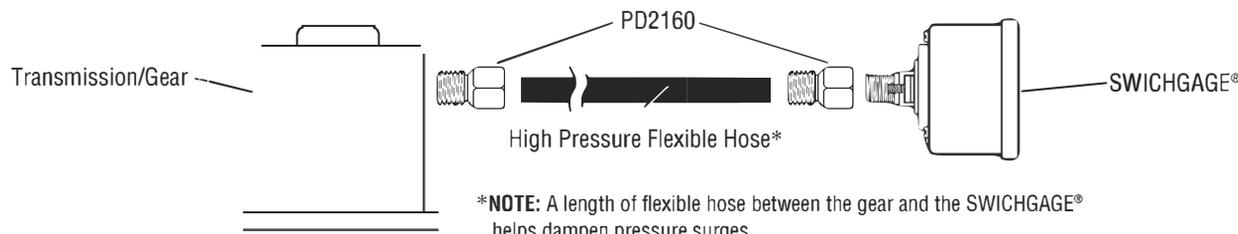

ENOVATION CONTROLS CORPORATE HEADQUARTERS
 5311 S 122ND EAST AVENUE
 TULSA, OK 74146

ENOVATION CONTROLS LTD. – UNITED KINGDOM
 CHURCH ROAD LAVERSTOCK
 SALISBURY SP1 1QZ UK

SUN MURPHY INTERNATIONAL TRADING (SHANGHAI) CO., LTD.
 B15 ROOM, 6# BUILDING, 351 SIZHUAN ROAD
 SONGJIANG DISTRICT, SHANGHAI 201601, CHINA

ENOVATION CONTROLS INDIA PVT. LTD.
 301, 3RD FLOOR, KRSNA CHAMBERS,
 11 GALAXY GARDENS, NORTH MAIN ROAD,
 KOREGAON PARK, PUNE 411001,
 MAHARASHTRA, INDIA

U.S. SALES & SUPPORT

PHONE: 918 317 4100
 EMAIL: SALES@ENOVATIONCONTROLS.COM
 WWW.ENOVATIONCONTROLS.COM

MURPHY INDUSTRIAL PANEL DIVISION

PHONE: 918 317 4100
 EMAIL: IPDSALES@ENOVATIONCONTROLS.COM

INTERNATIONAL SALES & SUPPORT

EUROPE, MIDDLE EAST, AFRICA
 PHONE: +44 1722 410055
 EMAIL: SALES@ENOVATIONCONTROLS.EU

CHINA
 PHONE: +86 21 6237 5885
 EMAIL: APSALES@ENOVATIONCONTROLS.COM

INDIA
 PHONE: +91 91581 37633
 EMAIL: INDIASALES@ENOVATIONCONTROLS.COM



FM 28221 (Tulsa, OK - USA)
 FM 29422 (UK)